
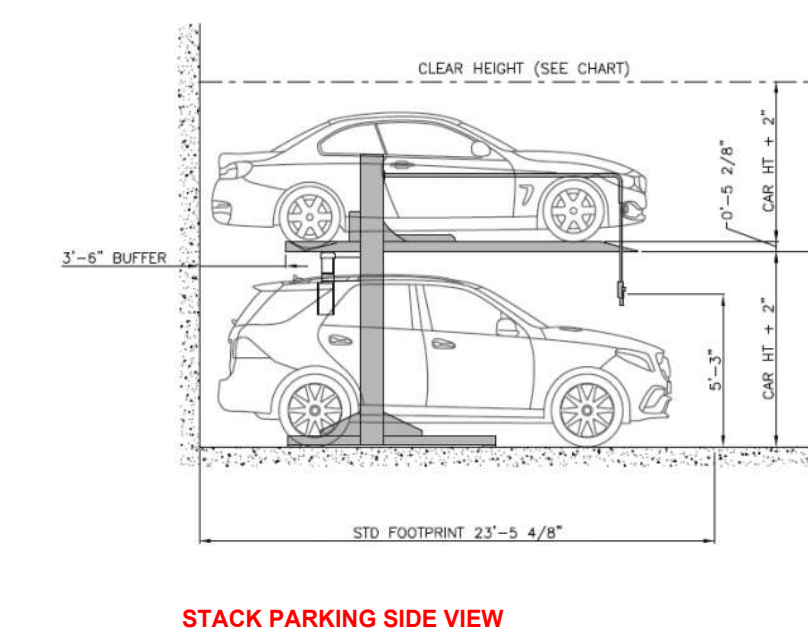
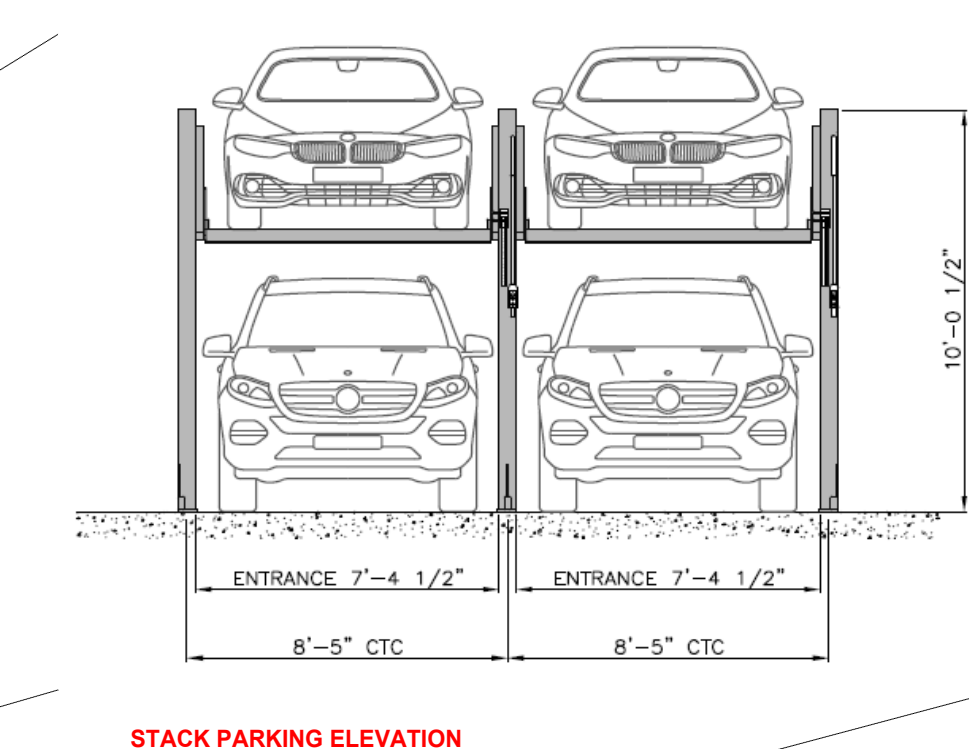


P-3 LEVEL SPRINKLERS  
0'-10" = 1' FLOOR

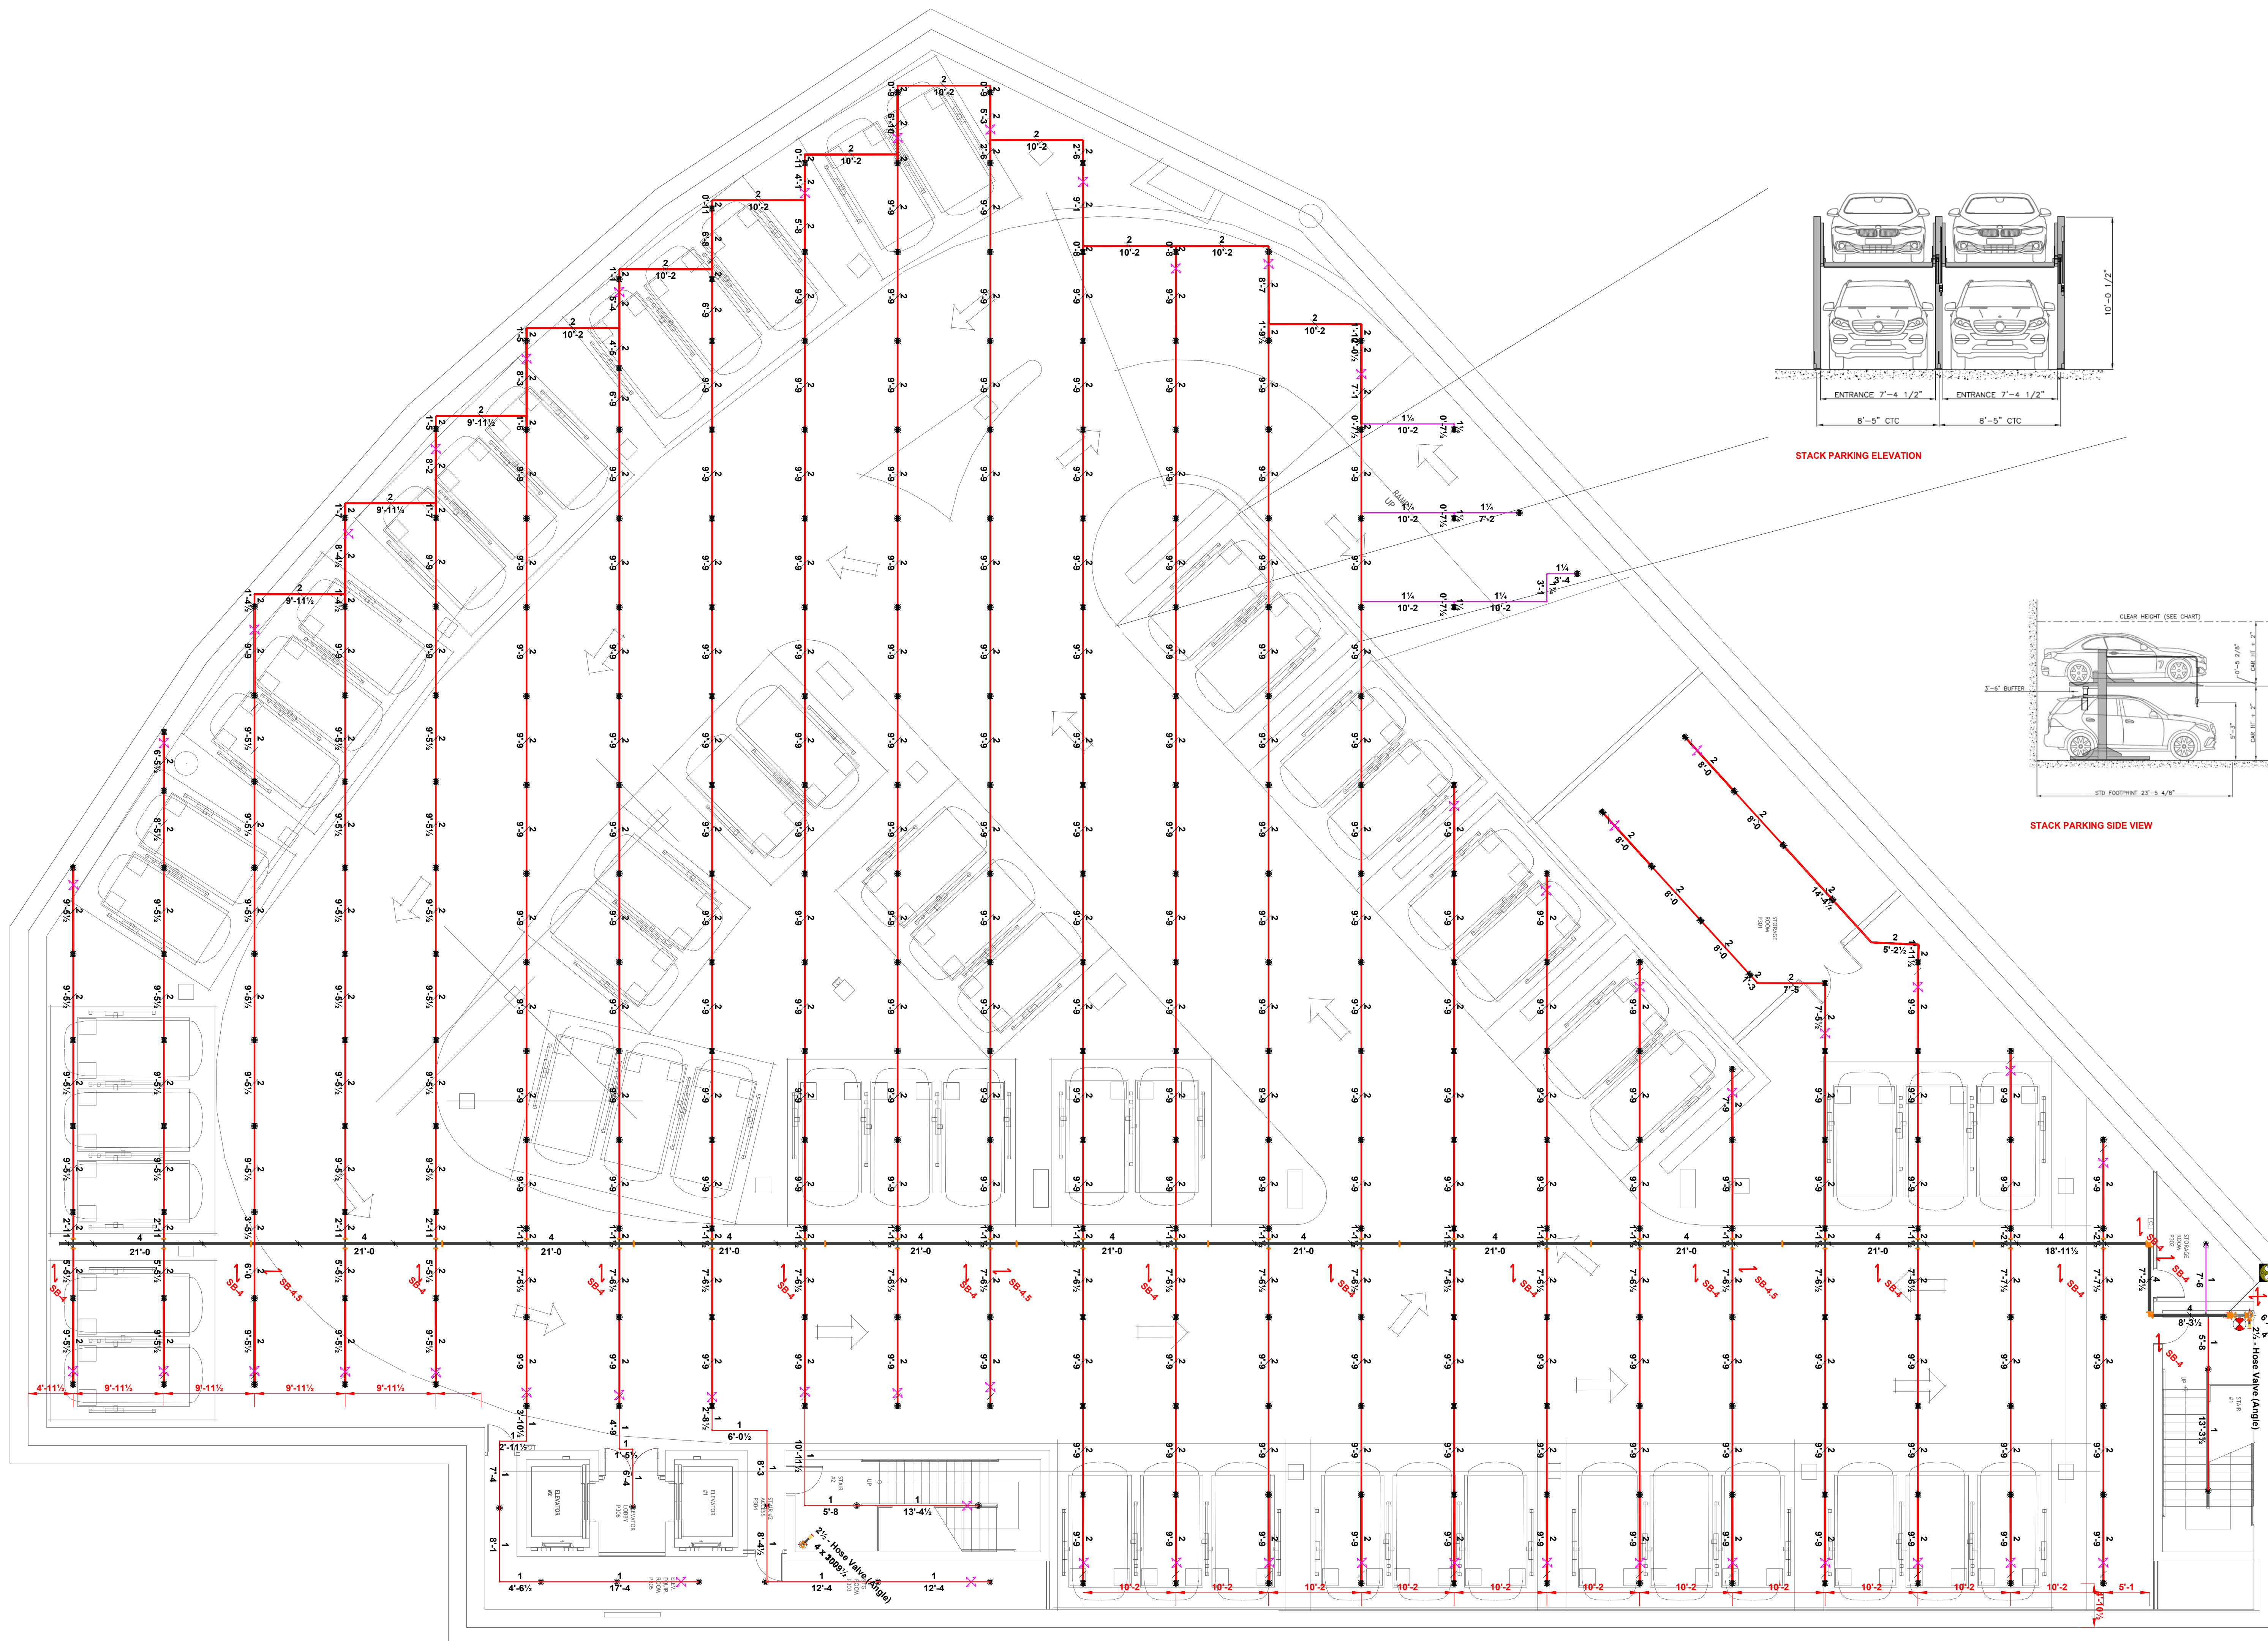

PLOTT DATE: 09/21/23 14:59:21

STANDARD SYMBOLS	STANDARD SYMBOLS
4-WAY BRACE	FDC FIRE DEPARTMENT CONNECTION
LATERAL BRACING	FH FIRE HYDRANT
LONGITUDINAL BRACE	CM CROSS MAIN
PIPE HANGER	FM FEED MAIN
HYD. REF. POINT	FR FEED RISER
	BR BRANCH LINE
	UG UNDERGROUND
	SB? SWAY BRACING

STANDARD SYMBOLS	STANDARD SYMBOLS
EOL; END OF THE LINE RESTRAIN	FS FLOW SWITCH
FLOW SWITCH CHECK VALVE	CV CHECK VALVE
RISER	LONG EAR RISER CLAMP
BUTTER FLY VALVE	BFV BUTTER FLY VALVE

SPRINKLER LEGEND											
Symbol	Manufacturer	SIN	Model	Quantity	K-Factor	Type	Size	Response	Finish	Temperature	Note
	Viking	18268	VK200	278	8	Upright	1/2"	Standard	Brass	155°F	
	Viking	23870	VK3021	14	5.6	Pendent	1/2"	Quick	Chrome	155°F	
				Total = 292							

DATE	REVISIONS

**PRIME FIRE PROTECTION INC.**  
1332 ALLEN GLENDALE, CA 91201  
TEL: (818) 914-9313

C19 LICENSE NO. 963462  
EMAIL: PRIMEFIREPROS@GMAIL.COM

PROJECT: **PACE CLINIC  
KIMBALL HIGHLAND  
NATIONAL CITY, CA 91950**

STAMP: *Varad Natamian*

KEY PLAN:

SHEET NAME: **PARKING LEVEL 3 SPRINKLERS**

OCCUPANCY: **STACK PARKING**

APPROVING AGENCY: **NATIONAL CITY FD**

DESIGN BY: **RM**

SHEET NO. **FP-P3**

SCALE: 1/8" = 1'-0"