

MODEL	DUCT SIZE	A	B	C	D	E	F	FREE AREA
SFX 8	8	7 1/16	10 5/8	9 7/16	5 23/32	2 3/32	3/4	0.14 sq.ft.

NOTE: PRODUCT INFORMATION IS SUBJECT TO CHANGE WITHOUT NOTICE. ALL DIMENSIONS IN INCHES.

10 SCALE NONE SEIHO SFX 8 INTAKE VENT CAP DETAIL

18 INSTALLATION

Venting the Dryer

WARNING

- Do not crush or collapse ductwork.
- Do not allow ductwork to rest on or contact sharp objects.
- If connecting to existing ductwork, make sure it is suitable and clean before installing the dryer.
- Venting must conform to local building codes.
- Gas dryers MUST exhaust to the outdoors.
- Use only 4-inch (10.2 cm) rigid, semi-rigid or flexible metal ductwork inside the dryer cabinet and for venting outside.
- To reduce the risk of fire, combustion, or accumulation of combustible gases, DO NOT exhaust dryer air into an enclosed and unventilated area, such as an attic, wall, ceiling, crawl space, chimney, gas vent, or concealed space of a building.
- To reduce the risk of fire, DO NOT exhaust the dryer with plastic or thin foil ducting.
- The exhaust duct must be 4 inches (10.2 cm) in diameter with no obstructions. The exhaust duct should be kept as short as possible. Make sure to clean any old ducts before installing your new dryer.
- Rigid, semi-rigid or flexible metal ducting is recommended for use between the dryer and the wall. All non-rigid metal transition duct must be UL-listed. Use of other materials for transition duct could affect drying time.
- DO NOT use sheet metal screws or other fasteners which extend into the duct that could catch lint and reduce the efficiency of the exhaust system. Secure all joints with duct tape.
- Do not exceed the recommended duct length limitations noted in the chart. Failure to follow these instructions may result in extended drying times, fire or death.

WARNING

- Ductwork is not provided with the dryer. You should obtain the necessary ductwork locally. The vent hood should have hinged dampers to prevent backdraft when the dryer is not in use.
- The total length of flexible metal duct must not exceed 8 ft. (2.4 m).

Ductwork


Wall Cap Type	Number of 90° Elbows	Maximum length of 4-inch diameter rigid metal duct
Recommended	0	65 ft. (19.8 m)
	1	55 ft. (16.8 m)
	2	47 ft. (14.3 m)
a. 4" (10.2 cm)	3	36 ft. (11.0 m)
	4	28 ft. (8.5 m)
Use only for short run installations	0	55 ft. (16.8 m)
	1	47 ft. (14.3 m)
	2	41 ft. (12.5 m)
b. 2.5" (6.35 cm)	3	30 ft. (9.1 m)
	4	22 ft. (6.7 m)

NOTE

- Deduct 6 ft. (1.8 m) for each additional elbow. Do not use more than four 90° elbows.
- In Canada, only those foil-type flexible ducts, if any, specifically identified for use with the appliance by the manufacturer should be used. In the United States, only those foil-type flexible ducts, if any, specifically identified for use with the appliance by the manufacturer and that comply with the Outline for Clothes Dryer Transition Duct, Subject 2158A, should be used.

10 SCALE NONE DRYER VENT INSTRUCTIONS


EAST ELEVATION

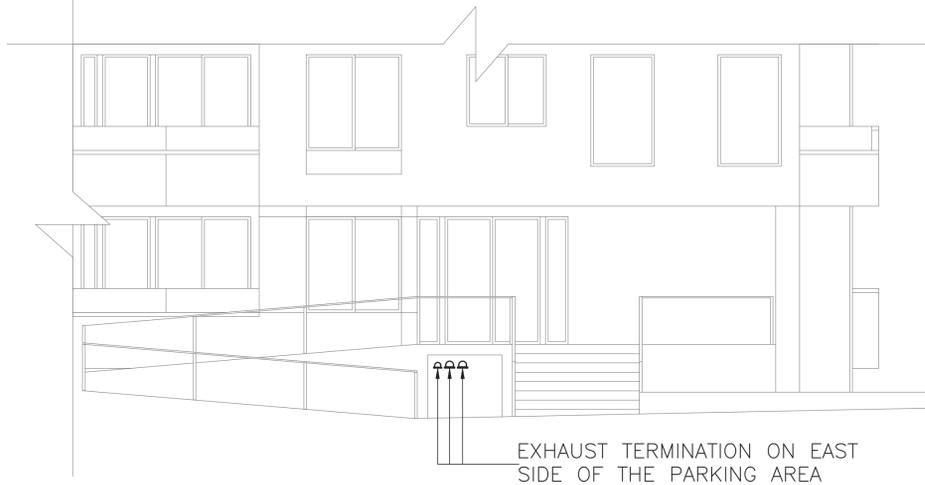

EXHAUST TERMINATION ON EAST SIDE OF THE PARKING AREA

NOTE: EXHAUST TERMINATIONS ARE DIRECTLY UNDER A DECK. AIR WILL HAVE TO TRAVEL HORIZONTALLY ALONG THE DECK, UPWARD. THEREFORE, NOT AFFECTING PEDESTRIANS.

LEVEL 2 (NORTH EAST) PLAN

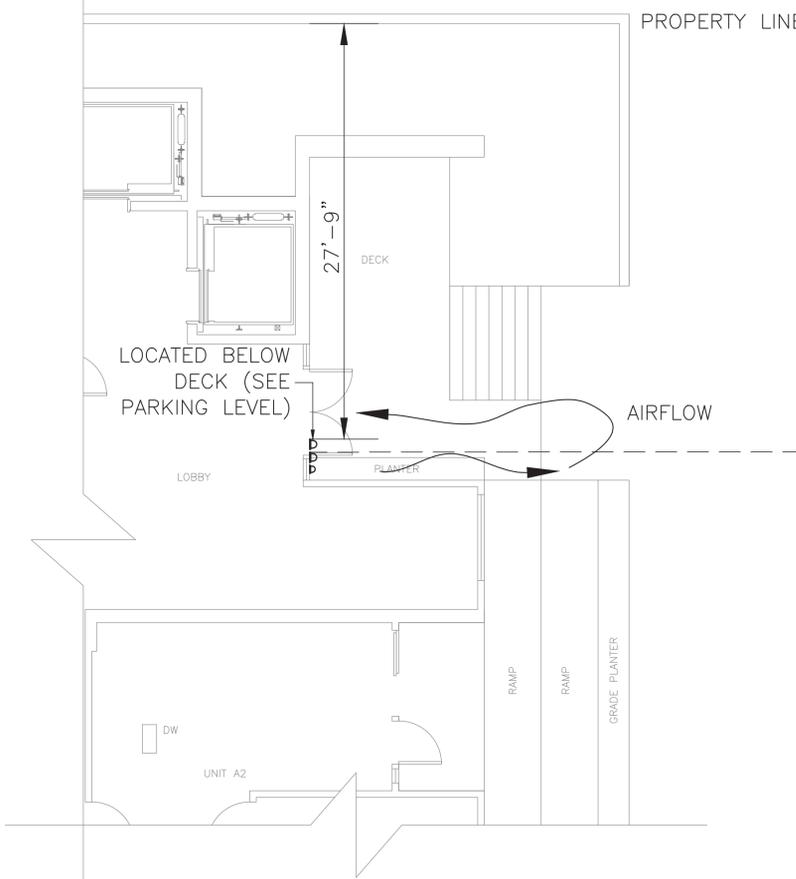


LOCATED BELOW DECK (SEE PARKING LEVEL)

PROPERTY LINE

AIRFLOW

PARKING LEVEL (NORTH EAST) PLAN

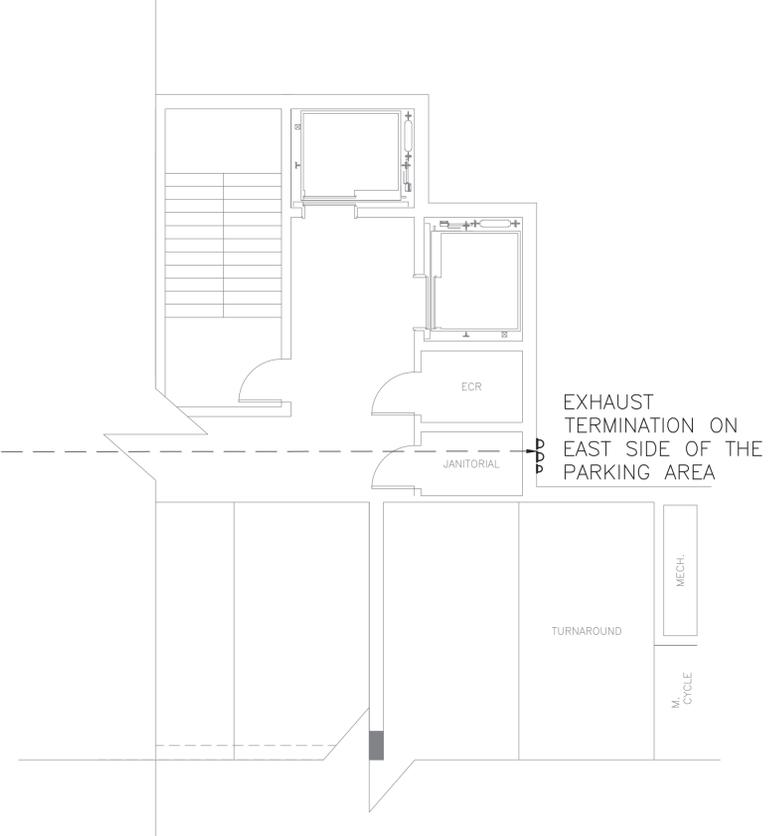

EXHAUST TERMINATION ON EAST SIDE OF THE PARKING AREA

11 SCALE NONE EXTERIOR EXHAUST ELEVATION AND PROPERTY LINE DETAIL

REV	DESCRIPTION	DATE
1	DESIGN CHANGES	02/23/22
2	FC COMMENTS	11/22/22
3	FC COMMENTS	12/22/22

COASTAL FORM ARCHITECTS
 2002 Jimmy Durante Blvd.
 Suite 200
 Del Mar, CA 92014
 858.531.9884
 www.coastalform.com
 info@coastalform.com

**4060 OREGON STREET
 48 MICRO UNIT APARTMENT**
 4060 OREGON STREET
 SAN DIEGO, CA 92104

1111 6th Ave. #111
 San Diego, CA 92101
 phone: (619) 734-4468
 fax: (619) 594-2932
 www.enr.com



This set of plans and specifications shall be kept on the site of the structure or work at all times during which work authorized by these plans is in progress, and shall be made available to city officials upon request. It is unlawful to change, modify, or alter the approved plans and specifications without the approval of the Building Official. The stamping of these plans and specifications SHALL NOT be held to permit or approve the violation of any City, County, State, or Federal laws, or restrictions.

MECHANICAL DETAILS
 PRJ-1045942
 Nikla Stamenkovic

JOB NO: B1910-AA031
 DRAWN: ME
 CHECKED: CZ
 SCALE: NONE
 DATE: 10.21.2021

M3.2